

Solis Standard Operating Procedure

IgFollow Quick Changeover Feature Enable version 1.0

Overview


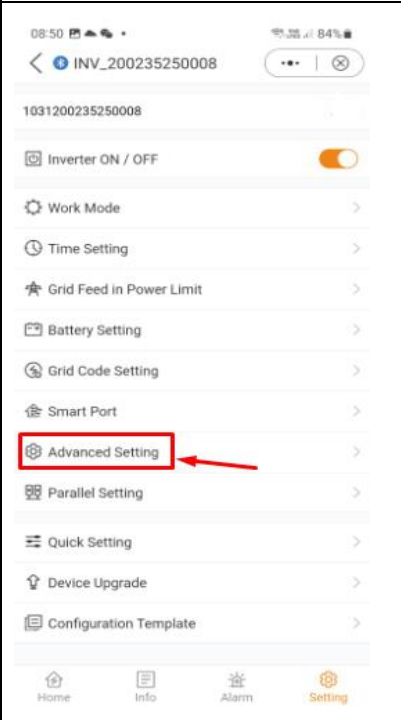
When IgFollow has not been enabled on a Solis hybrid inverter it results in slower than expected change over times on a grid failure. By enabling the IgFollow function will allow for much quicker grid-failure change overs.

Method

Quick Overview

1. Login to the inverters Bluetooth admin
2. Select the **“Settings”** menu option.
3. Select the **“Advanced Settings”** menu item.
4. Select **“Special Function Setting 1”** menu item.
5. Switch the **“IgFollow”** switch to the on position (turns Blue)
6. The IgFollow has now been enabled resulting in quicker changeover times.

Detailed Step-By-Step

Step 1: Once logged into Bluetooth, select “Settings”	Step 2: Select the “Advanced Setting” menu item
 <p>The screenshot shows the main dashboard with various energy statistics. At the bottom, there is a navigation bar with icons for Home, Info, Alarm, and Settings. The Settings icon is highlighted with a red box.</p>	 <p>The screenshot shows the 'Advanced Setting' menu with various options. The 'Advanced Setting' option is highlighted with a red box and a red arrow pointing to it.</p>

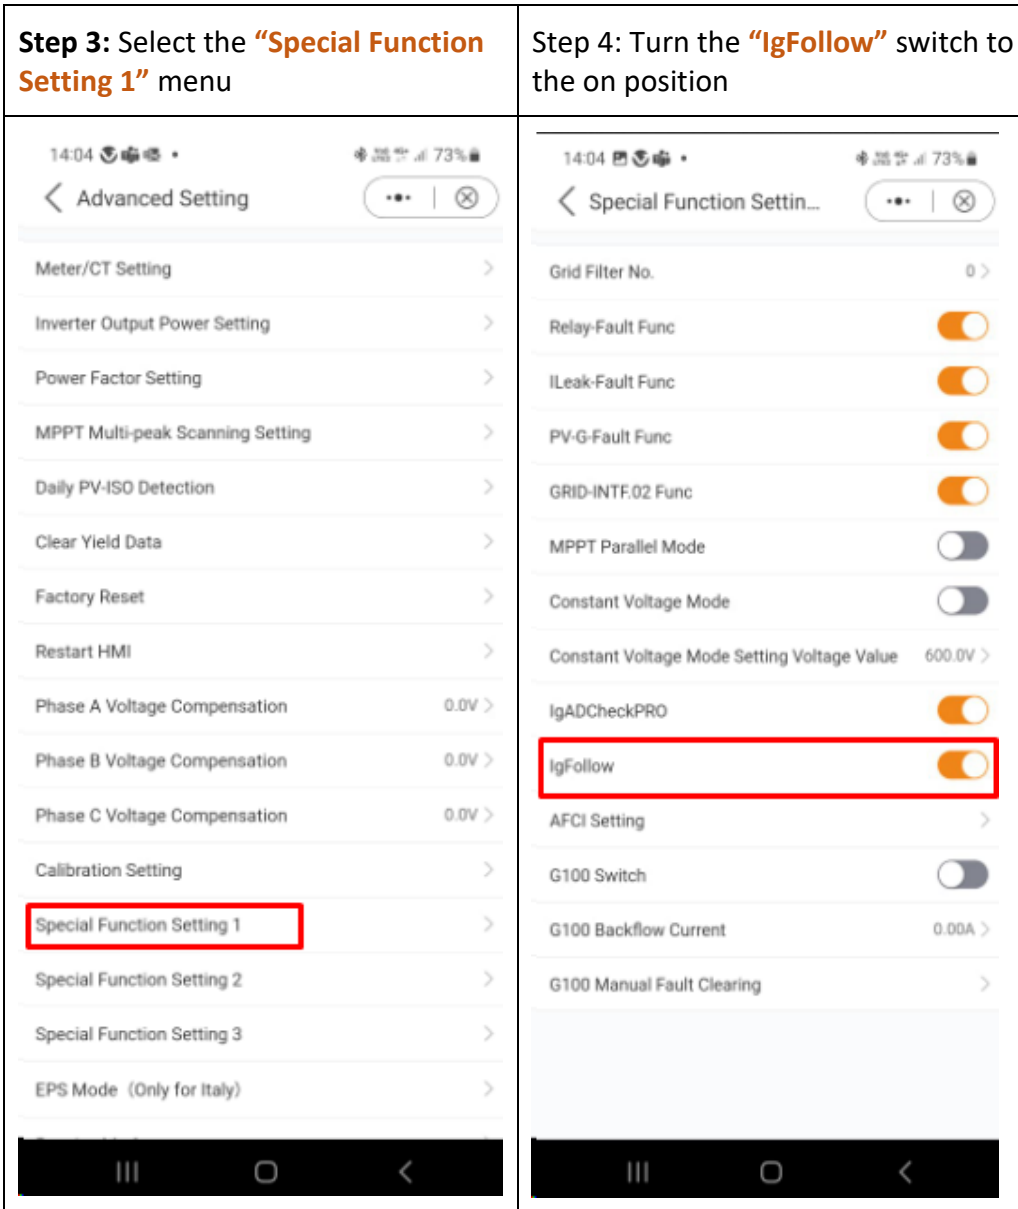


Figure 1 - Before Switching



Figure 2 - After Switching On